

M-OUT-4s configuration guide

Document number: PO-096-EN Version: 5.0 Date of publication: October 9, 2024

Introduction

The M-OUT-4s module is equipped with voltage analogue outputs that allow it to integrate with devices that have voltage control inputs compatible with 0 – 10V DC, 1 – 10V DC, or 0 – 5V DC standards.

This allows the module to control, among others.:

- light fixtures,
- recuperators,
- inverters, etc.



The module's four outputs allow independent control of four receivers; the outputs can accept values from 0 - 10V DC. With this module it is possible, for example, to make the supply power dependent on the temperature received from the heating zone.

Configuration in Ampio Designer


Device parameters

To change the device parameters, enter the device settings (cog icon) and select the *Parameters* tab on the left. In the subtab *Curve value* it is possible to set the control for each channel separately.

Curve value

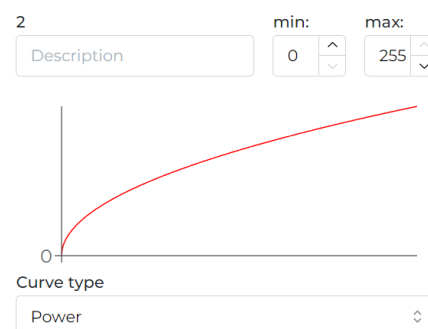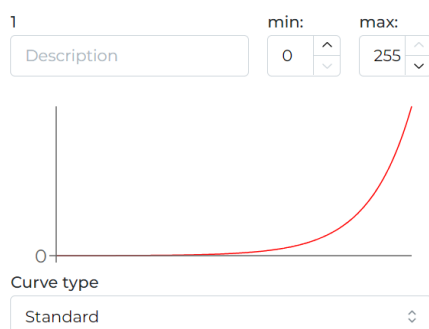


The output can be controlled in a linear fashion in several different ways. Furthermore, the start and end of the control do not have to be 0 and 100% either (select any value from the range 0-255). After the change, send the new parameters to the device.

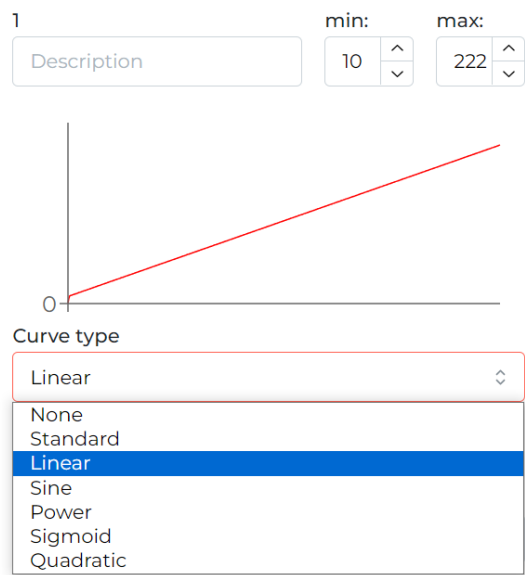


Device monitor

The current values can be viewed and set in the *Functions* tab, *0-10V output* sub-tab.

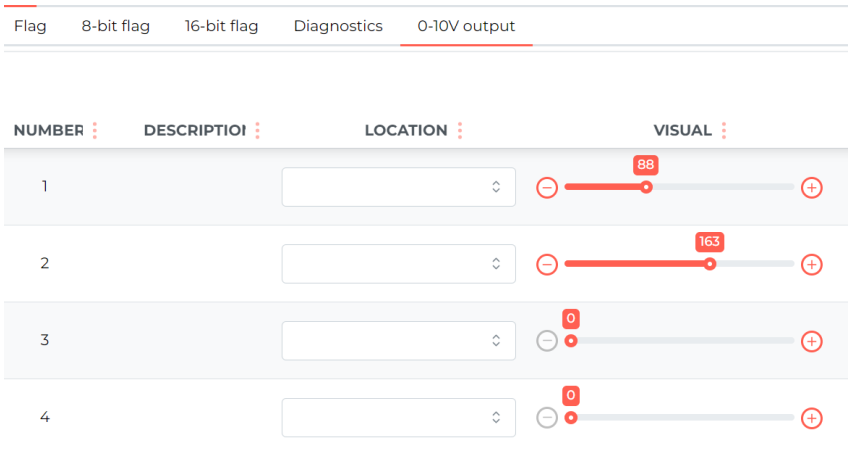

Conditions

Logical conditions can be created both from output values and to control outputs. Detailed function parameters are set by clicking on the cog icon on the dark background.

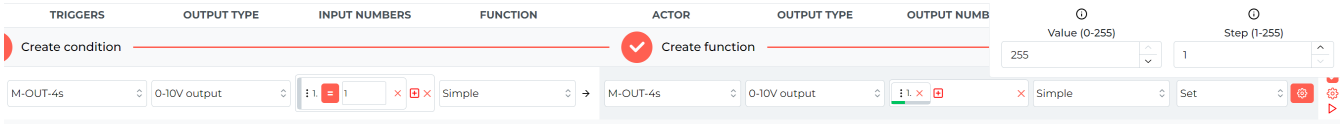


Configuration in Smart Home Configurator*


*from January 2024, the Smart Home Configurator software is no longer being developed. It is recommended to use it only in substantiated instances.

Device monitor

The M-OUT-4s module is configured in the Ampio Smart Home configurator. In order to check if the module is working correctly, open the *Device monitor*. There, you can also activate the outputs and name them. To save your changes, click *Save names*.

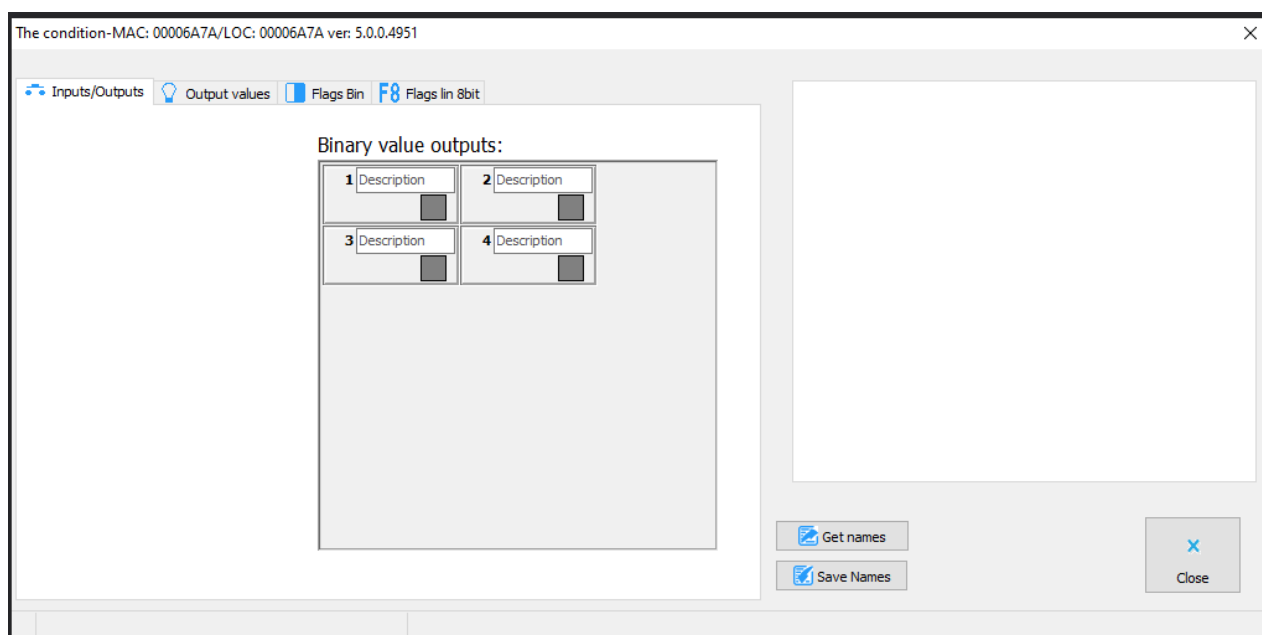

Apart from the simple on/off information, in the *Output values* tab you can also define a value per output within the range of 0-255 (which corresponds to 0-10V).

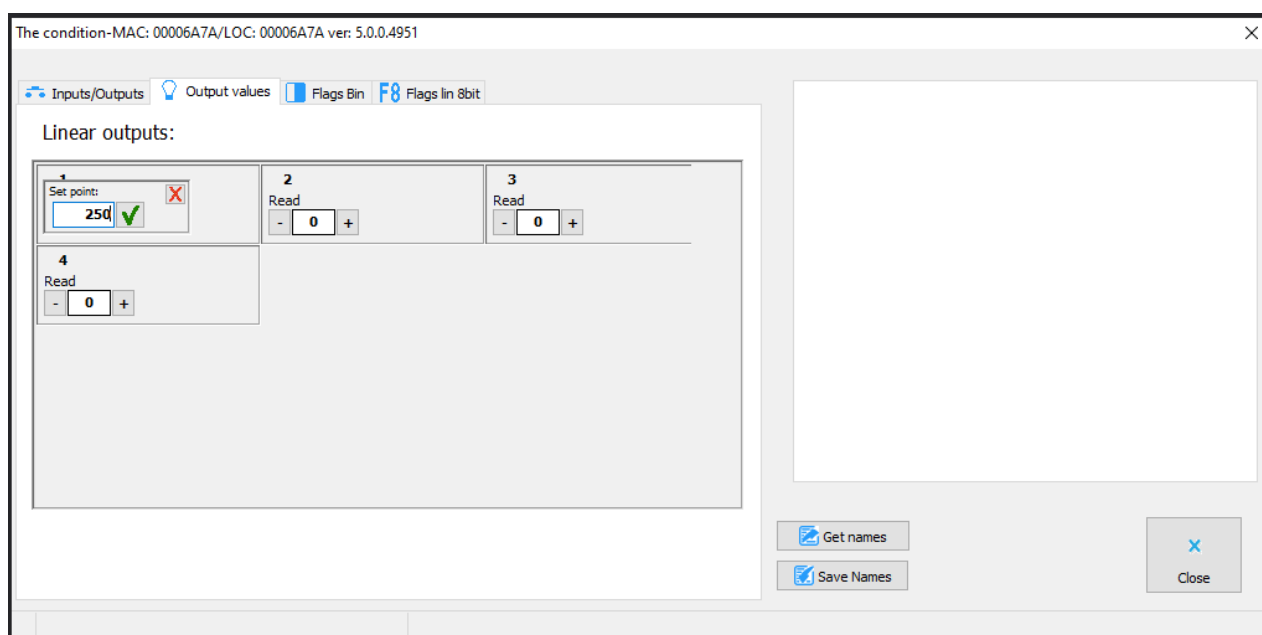

Flags in this module work in exactly the same fashion as it is the case with all the other Ampio system modules.

Device parameters

Next, go to the *Device parameters* tab. Open *Outputs*, where you can define the value to which selected devices will be set after power supply is reset.

Device parameters-MAC: 00006A7A/LOC: 00006A7A ver: 5.0.0.4951

OUTPUTS **FLAGS Bin** F8 FLAGS Lin8 Curves

Initial values of outputs:

1	VALUE	98	0 .. 255
2	VALUE	53	0 .. 255
3	VALUE	174	0 .. 255
4	VALUE	80	0 .. 255

Load Set default Send

The initial values can also be defined for selected flags in the *FLAGS Bin* and *FLAGS Lin8* tabs. The *Curves* tab provides options for specifying how an output should be activated. Select the control range - for some devices a range between, e.g. 20% and 80% is advantageous. Then, select one curve from the list - this will allow the output to be activated more smoothly. Available curves are: *line*, *logarithmic*, *sine*, *tangent*, and *arc tangent*. After confirming, you will see a graph corresponding to the setting. Once this stage of configuration is completed, click on *send to device*.

Device parameters-MAC: 00006A7A/LOC: 00006A7A ver: 5.0.0.4951

OUTPUTS **FLAGS Bin** F8 FLAGS Lin8 **Curves**

Curves of linear outputs:

Output no.: 1

Curve type: Logarithmic

Range [%]: 0 .. 100 ☒

Output no.: 2

Curve type: No data

Output no.: 3

Curve type: Sine

Range [%]: 0 .. 100 ☒


Output no.: 4

Curve type: No data


Load Set default Send

Conditions

When creating conditions in Smart Home configuration, you can establish dependencies from the M-OUT-4s module. Dependencies can be created from the output's status, output's value, or output's flag. If you want to check whether an output is switched on, or not, tick the appropriate output in the *Inputs/Outputs* tab (Binary value outputs).

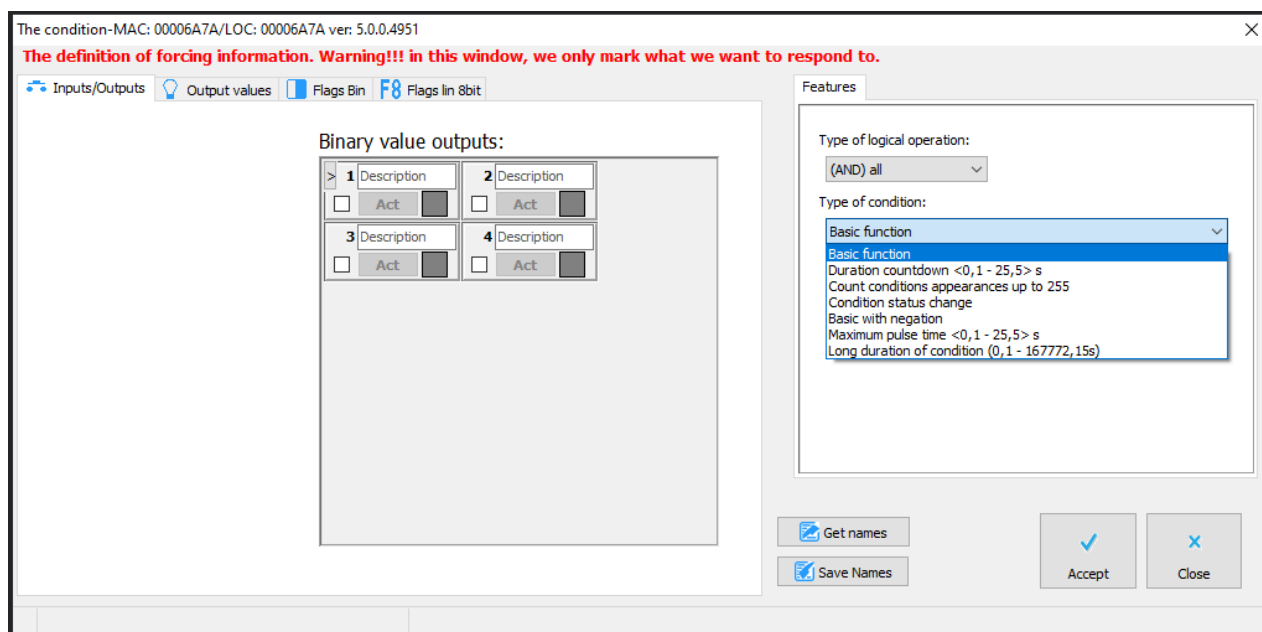


If you would like to ascertain whether the selected output has reached its set value (e.g. 100), you can do that in the *Output values* tab.

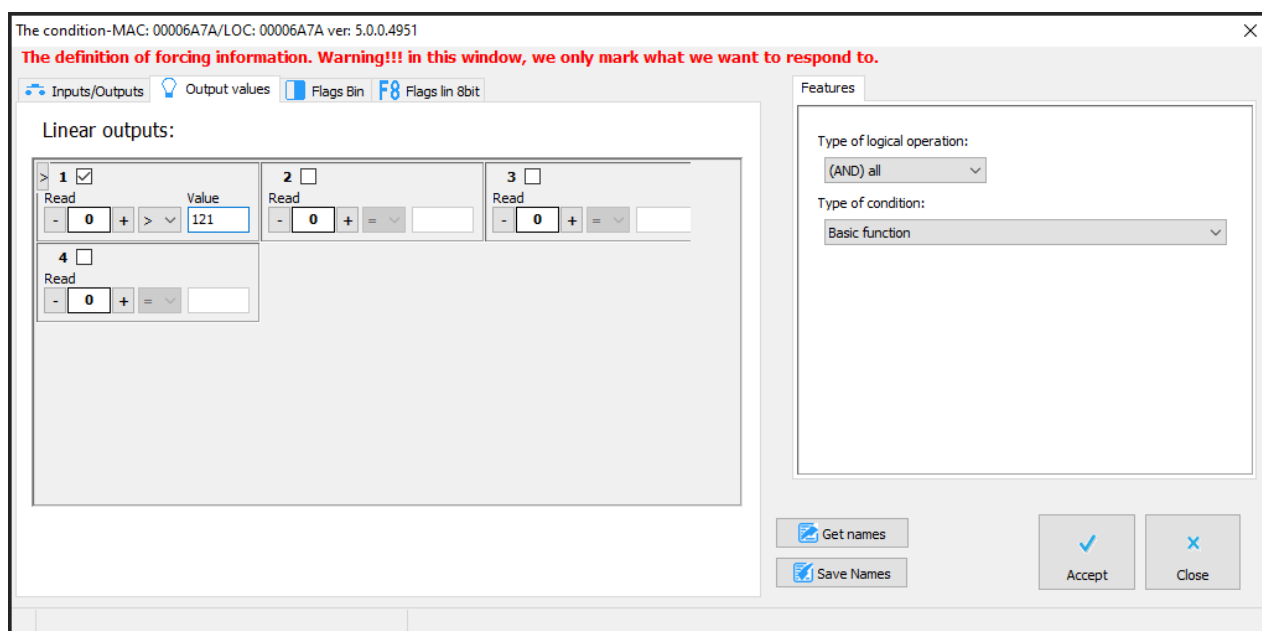

Device reactions


As a reaction to any condition, you can select one of various functions that can be controlled by M-OUT-4s' outputs. In the figure below, on the left side, there is an overview of current values, which can be edited to test the reaction of a given output.

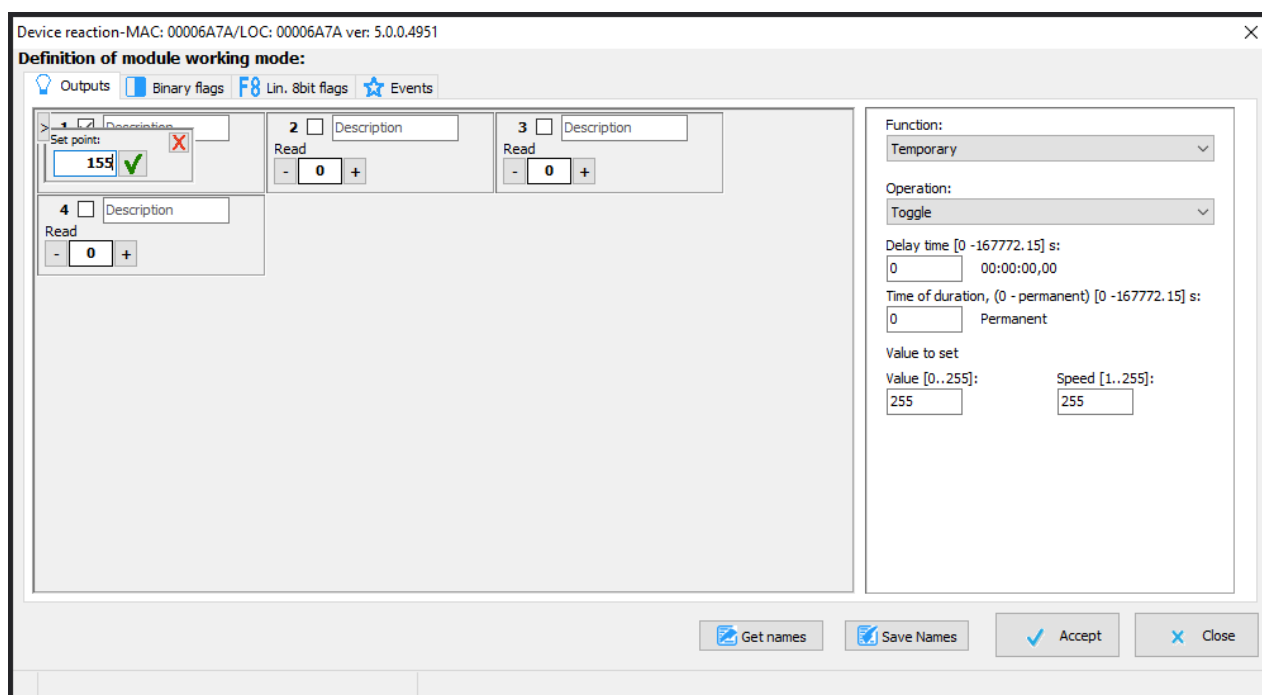

In the same window, on the right side, there is a list of functions that can be selected for a given condition, as well as the function parameters. Due to the fact that the module's outputs can not only be switched on/off, but also accept values in the range of 0-255, a lot of configuration possibilities are available.

For example, you can get a value from the source device (first part of the condition), calculate it and set the calculated value on M-OUT-4s' output.

In the figure below, an 8-bit value is downloaded, number 1 (e.g. 1 output) selected, data type prescaler is left on default, and the value in the converter is multiplied by 2. Saturation limits the value to the range of 20 to 200. This means that if the input returns 0, the output will receive 20 (the *minimum* limit). With an input returning 30, the output will take the value of 60. With an input returning 220, the output will take the value of 200 (the *maximum* limit).

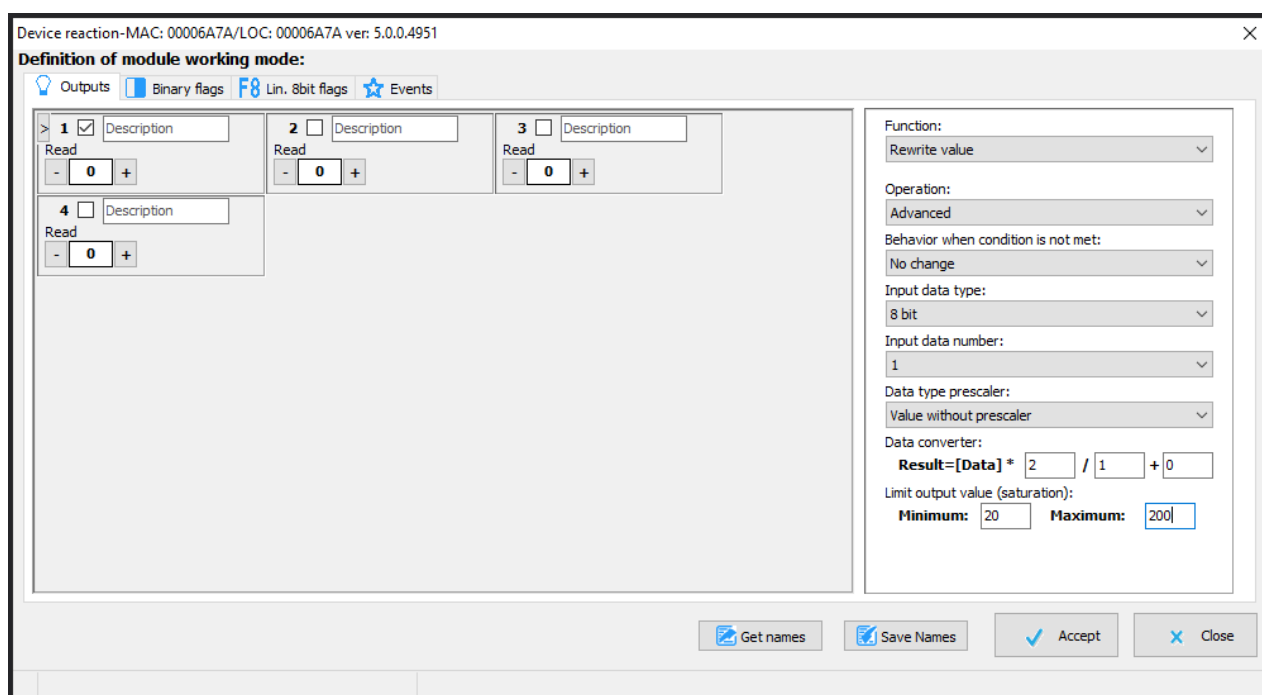

Once the condition is created, it is necessary to confirm it and send it to device.